


JOB: UNIT TAG: ENGINEER: CONTRACTOR:	REPRESENTATIVE: ORDER NO. SUBMITTED BY: APPROVED BY:	DATE: DATE: DATE:
---	---	--

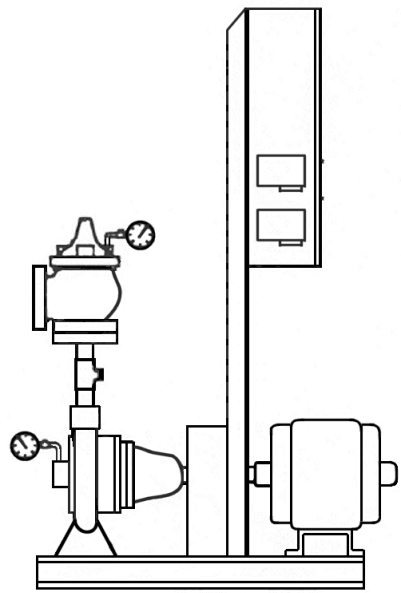

70M Series Simplex Pressure Booster System

DESIGN DATA:	System Capacity: _____	GPM
	Pressure Required @ Discharge Header: _____	PSIG
	Pressure Drop through Package (include PRV): _____	PSIG
	Minimum Suction Pressure: _____	PSIG

PUMP DATA:	Series: _____ 1510 _____	Size _____
	Gallons Per Minute: _____	_____
	Pump TDH (feet) _____	_____
	PRV Size _____	_____
	Motor HP furnished: _____	_____
	Motor RPM: Voltage _____ Hertz _____ Phase _____	


STANDARD EQUIPMENT: Basic unit fully piped, wired, tested and mounted on steel frame. Includes bronze-fitted B&G Series 1510 pump and motor, suction and discharge gauges, combination pressure reducing and nonslam check valve. Starter panel with fused disconnect, hand-off-auto and low suction cut-out.

OPTIONAL EQUIPMENT:

Control Panel

Yes Microprocessor Panel (See Submittal D-216)

No Simplex MiniBooster Panel

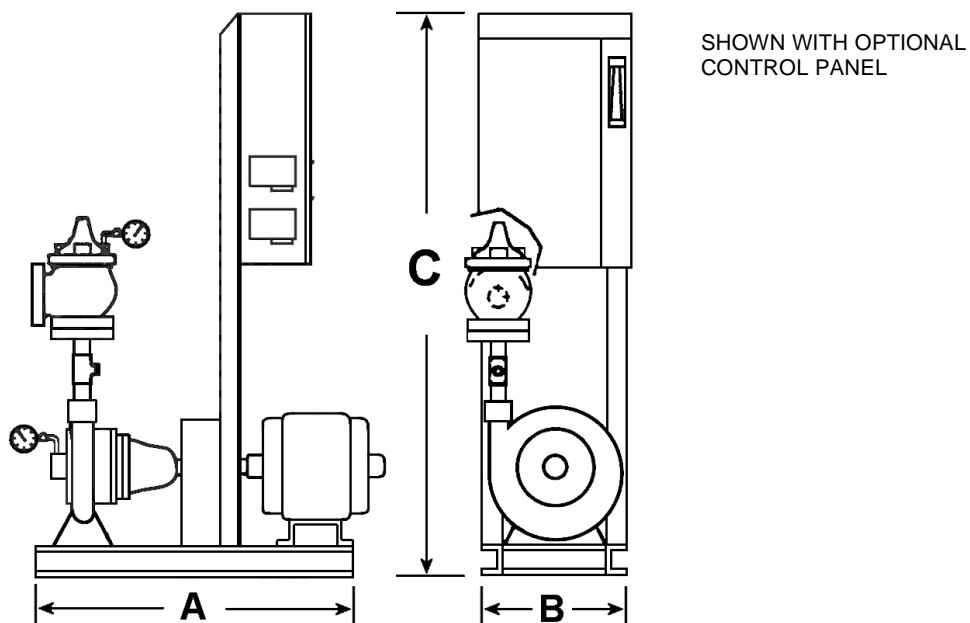

Dimensions (inches)	A	B	C*
Maximum	62	30	55
Minimum	30	24	45

*Applicable to units with optional control panel.

Consult factory for unit dimension with a combined horsepower over 100.
 "Do not use for construction. Dimensions are approximate and subject to change.
 Contact factory for certified dimensions."